



FIGURE 3-4

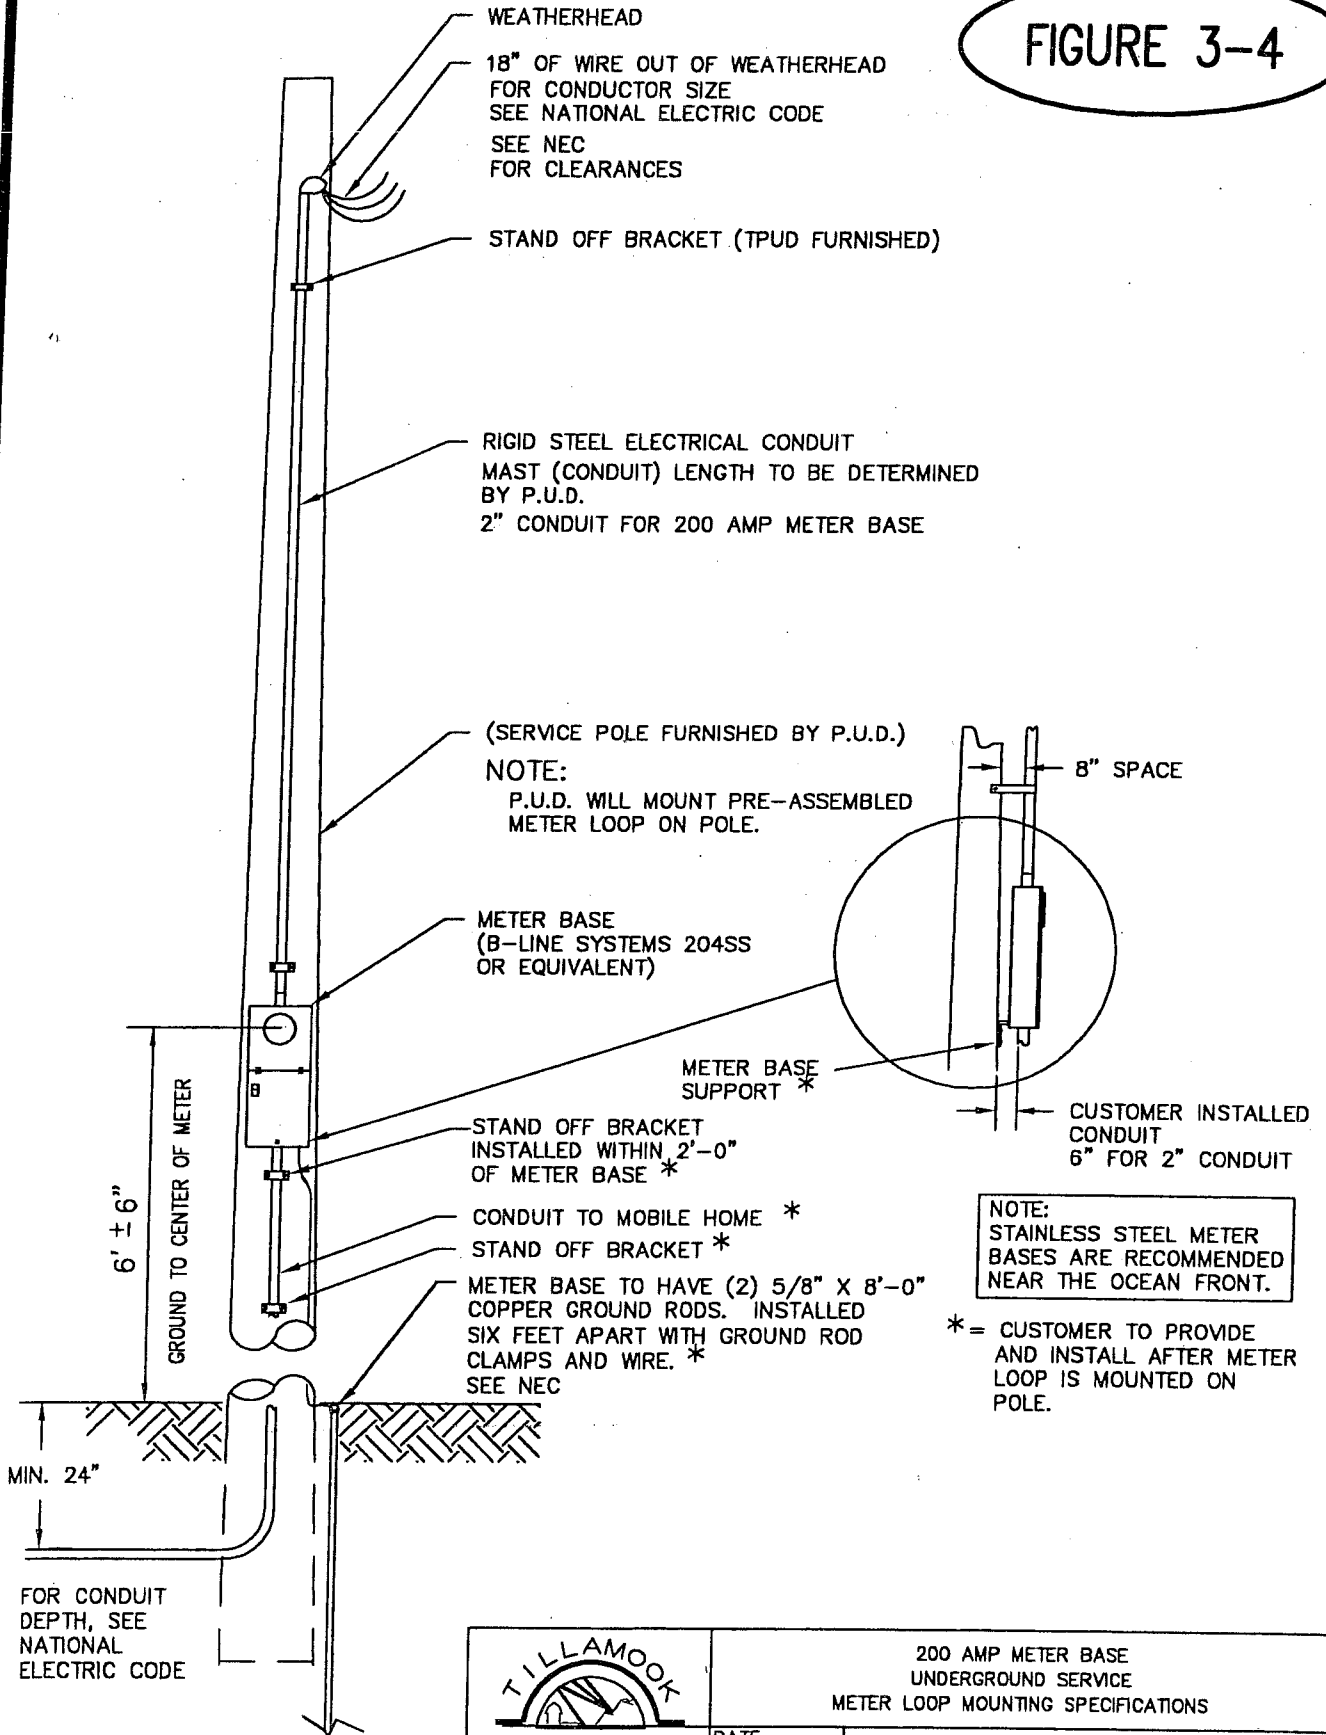

NOTE:
STAINLESS STEEL METER BASES ARE RECOMMENDED NEAR THE OCEAN FRONT.

* = CUSTOMER TO PROVIDE AND INSTALL AFTER METER LOOP IS MOUNTED ON POLE.

FOR CONDUIT DEPTH, SEE NATIONAL ELECTRIC CODE



DATE
11-18-03
DWN. BY
Tiffany Lima
DWG NAME
FIGURE3-4

200 AMP METER BASE
UNDERGROUND SERVICE
METER LOOP MOUNTING SPECIFICATIONS

TILLAMOOK P.U.D.
OREGON 24 TILLAMOOK

**TILLAMOOK PEOPLE'S UTILITY DISTRICT
CONSTRUCTION GUIDELINES
MOBILE HOME UNDERGROUND
POLE MOUNTED METER BASE**

1. The customer is responsible for providing the meter loop/disconnect, as shown on the reverse, but should not order meter loop until the TPUD Engineering Representative has determined the height of the mast.
2. TPUD will hang the pre-assembled meter loop on the TPUD pole. Customer should then call the State Electrical Inspector for inspection.
3. Customer is responsible for obtaining State Electrical permit and State Inspection prior to the connection of electrical service. (State Electrical Inspector, 842-3440, located in Tillamook County Courthouse, Building Department).
4. If a service extension fee is required, the fee must be paid and line extension agreement signed prior to the installation of service.
5. Customer is responsible for filing an "Application for Service" card with the Engineering Department prior to scheduling the installation.
6. Cost estimates are good for 180 days only.
7. The customer will install and own the underground service from the pole to the mobile home.
8. Main disconnect (usually with metering) must be within 30 feet of mobile home.
9. If the mobile home is not on the site when electrical service is requested, corners of mobile and wire-out location must be staked.
10. Required easements, tree trimming permits, property descriptions, and signatures are the responsibility of the customer.

These are only general requirements. Customer must meet or exceed NEC requirements. More specific requirements may be made on individual installations.